


WALNUT PARK MUTUAL WATER COMPANY

2022 CONSUMER CONFIDENCE REPORT

Since 1991, California water utilities have been providing information on water served to its consumers. This report, prepared in May 2023, is a snapshot of the tap water quality that we provided last year. Included are details about where your water comes from, how it is tested, what is in it, and how it compares with state and federal limits. We strive to keep you informed about the quality of your water, and to provide a reliable and economic supply that meets all regulatory requirements.

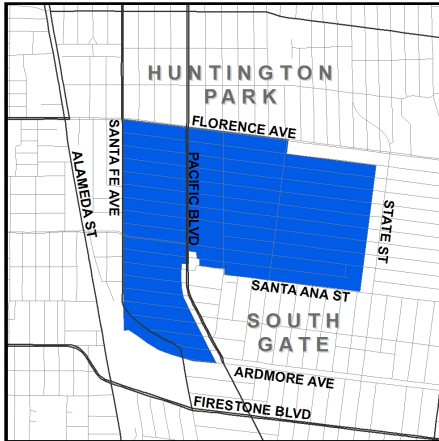

Where Does My Tap Water Come From?

Your tap water comes from the Central Basin. These local, deep groundwater wells supply our service area shown on the adjacent map. The

quality of groundwater delivered to your home is presented in this report.

How is My Drinking Water Tested?

Your drinking water is tested regularly for unsafe levels of chemicals, radioactivity and bacteria at the source and in the distribution system. We test weekly, monthly, quarterly, annually or less often depending on the substance. State and federal laws allow us to test some substances less than once per year because their levels do not change frequently. All water quality tests are conducted by specially trained technicians in state-certified laboratories.

What Are Drinking Water Standards?

The Federal Environmental Protection Agency (USEPA) limits the amount of certain substances allowed in tap water. In California, the State Water Resources Control Board (State Water Board) regulates tap water quality by enforcing limits that are at least as stringent as the Federal EPA's. Historically, California limits are more stringent than the Federal ones.

There are two types of these limits, known as standards. Primary standards protect you from substances that could potentially affect your health. Secondary standards regulate substances that affect the aesthetic qualities of water. Regulations set a Maximum Contaminant Level (MCL) for each of the primary and secondary standards. The MCL is the highest level of a substance that is allowed in your drinking water.

Public Health Goals (PHGs) are set by the California Environmental Protection Agency. PHGs provide more information on the quality of drinking water to customers, and are similar to their federal counterparts, Maximum Contaminant Level Goals (MCLGs). PHGs and MCLGs are advisory levels that are nonenforceable. Both PHGs and MCLGs are concentrations of a substance below which there are no known or expected health risks.

How Do I Read the Water Quality Table?

Although we test for over 100 substances, regulations require us to report only those found in your water. The first column of the water quality table lists substances detected in your water. The next columns list the average concentration and range of concentrations found in your drinking water. Following are columns that list the MCL and PHG or MCLG, if appropriate. The last column describes the likely sources of these substances in drinking water.

To review the quality of your drinking water, compare the highest concentration and the MCL. Check for substances greater than the MCL. Exceedence of a primary MCL does not usually constitute an immediate health threat. Rather, it requires testing the source water more frequently for a short duration. If test results show that the water continues to exceed the MCL, the water must be treated to remove the substance, or the source must be removed from service.

Why Do I See So Much Coverage in the News About the Quality Of Tap Water?

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

Contaminants that may be present in source water include:

- Microbial contaminants, including viruses and bacteria, that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife;
- Inorganic contaminants, such as salts and metals, that can be naturally-occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, oil and gas production, mining or farming;
- Pesticides and herbicides, which may come from a variety of sources such as agriculture, urban storm water runoff, and residential uses;

- Organic chemical contaminants, including synthetic and volatile organic chemicals, that are byproducts of industrial processes and petroleum production, and can also come from gas stations, urban storm water runoff, and septic systems;
- Radioactive contaminants, which can be naturally occurring or be the result of oil and gas production and mining activities.

In order to ensure that tap water is safe to drink, the USEPA and the State Water Resources Control Board (State Water Board) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. State Water Board regulations also establish limits for contaminants in bottled water that must provide the same protection for public health.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the U.S. EPA's Safe Drinking Water Hotline (1-800-426-4791). You can also get more information on tap water by logging on to these helpful web sites:

- <https://www.epa.gov/ground-water-and-drinking-water/safe-drinking-water-information>
(USEPA's web site)
- http://www.waterboards.ca.gov/drinking_water/certification/drinkingwater/NotificationLevels.shtml
(State Water Board web site)

If present, elevated levels of lead can cause serious health problem, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. Walnut Park Mutual Water Company is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <http://www.epa.gov/lead>.

Should I Take Additional Precautions?

Some people may be more vulnerable to contaminants in drinking water than the general population. Immunocompromised persons such as persons with cancer undergoing chemotherapy, persons who have

undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people

should seek advice about drinking water from their health care providers. The USEPA/Centers for Disease Control guidelines on appropriate means to lessen the risk of infection of *Cryptosporidium* and other microbial contaminants are available from the Federal EPA's Safe Drinking Water Hotline (1-800-426-4791).

Source Water Assessment

Walnut Park Mutual Water Company completed its source water assessment in 2001. Groundwater supplies are considered most vulnerable to chemical/petroleum pipelines, above ground storage tanks, Well-water supply, monitoring wells/test holes, automobile gas stations, automobile repair shops, parking lots/malls with more than 50 spaces, railroads, medical/dental offices/clinics, apartments and condominiums, and NPDES/WDR permitted discharge. A copy of the approved assessment may be obtained by contacting the main office at (323) 585-7321 or sending a written request to 2460 East Florence Avenue, Walnut Park, CA 90255.

How Can I Participate in Decisions On Water Issues That Affect Me?

The public is welcome to attend the Annual Shareholders meeting located at 2460 East Florence Avenue, Walnut Park, CA 90255 which will be held June 19, 2023 at 7:00 pm. Monthly Board meetings are held every 3rd Monday at 1:00 pm.

How Do I Contact My Water Agency If I Have Any Questions About Water Quality?

If you have specific questions about your tap water quality, please contact Dr. Michael Gomez at (323) 585-7321.

Some Helpful Water Conservation Tips

- Fix leaky faucets in your home – save up to 20 gallons every day for every leak stopped
- Save between 15 and 50 gallons each time by only washing full loads of laundry
- Adjust your sprinklers so that water lands on your lawn/garden, not the sidewalk/driveway – save 500 gallons per month
- Use organic mulch around plants to reduce evaporation – save hundreds of gallons a year
- Turn off the water while brushing your teeth and save 25 gallons a month.
- Visit <http://www.epa.gov/watersense> for more information.

Visit us at www.wpmwc.org

WALNUT PARK MUTUAL WATER COMPANY 2022 CONSUMER CONFIDENCE REPORT

Results are from the most recent testing performed in accordance with state and federal drinking water regulations
The State allows monitoring for some contaminants less than once per year because the concentrations of these contaminants do not change frequently.
Some of the data, though representative, are more than one year old

PRIMARY STANDARDS MONITORED AT THE SOURCE-MANDATED FOR PUBLIC HEALTH

VOLATILE ORGANIC CHEMICALS (µg/l)	GROUNDWATER		PRIMARY MCL	MCLG or PHG	MAJOR SOURCES IN DRINKING WATER
	AVERAGE	RANGE			
	(a)	(a)			
INORGANICS Sampled from 2020 to 2022 (b)					
Fluoride (mg/l)	0.37	0.35 - 0.42	2.0	1 (c)	Erosion of natural deposits, water additive that promotes strong teeth
Nitrate (mg/l as N)	0.40	ND - 0.59	10	10 (c)	Runoff and leaching from fertilizer use / septic tanks / sewage, natural erosion
RADIOLOGICAL - (pCi/l) (Results are from 2016 to 2022) (b)					
Gross Alpha	3.7	3.4 - 4.0	15	0	Erosion of natural deposits
Radium 226 (pCi/L)	0.06	ND - 0.17	5 (b)	0.05	Erosion of natural deposits
Radium 228 (pCi/L)	ND	ND		0.019	Erosion of natural deposits
Uranium	2.9	2.7 - 3.1	20	0.5 (c)	Erosion of natural deposits

PRIMARY STANDARDS MONITORED IN THE DISTRIBUTION SYSTEM - MANDATED FOR PUBLIC HEALTH

MICROBIALS	DISTRIBUTION SYSTEM		PRIMARY MCL	MCLG or PHG	MAJOR SOURCES IN DRINKING WATER
	AVERAGE # POSITIVE	RANGE # POSITIVE			
Total Coliform Bacteria	0	0	>1 positive	0	Naturally present in the environment. Coliforms are bacteria that are naturally present in the environment and are used as an indicator that other, potentially-harmful, bacteria may be present. Coliforms were found in more samples than allowed and this was a warning of potential problems.
Fecal Coliform and <i>E. Coli</i> Bacteria	0	0	0	0	Human and animal fecal waste
No. of Acute Violations	0	0	-	-	
DISINFECTION BY-PRODUCTS (e) AND DISINFECTION RESIDUALS					
	DISTRIBUTION SYSTEM		PRIMARY MCL	MCLG or PHG	MAJOR SOURCES IN DRINKING WATER
	AVERAGE	RANGE			
Trihalomethanes-TTHMS (µg/l)	3.1	ND - 3.6	80	-	By-product of drinking water chlorination
Haloacetic Acids (µg/l)	ND	ND	60	-	By-product of drinking water disinfection
Total Chlorine Residual (mg/l)	0.9	0.3 - 1.6	4.0 (f)	4.0 (g)	Drinking water disinfectant added for treatment
AT THE TAP PHYSICAL CONSTITUENTS 31 sites sampled in 2020					
	DISTRIBUTION SYSTEM		ACTION LEVEL AL	MCLG or PHG	MAJOR SOURCES IN DRINKING WATER
	90%ile	# OF SITES ABOVE THE AL			
Copper (mg/l)	0.27 (h)	0	1.3 AL	0.3 (c)	Internal corrosion of household plumbing, erosion of natural deposits
Lead (µg/l) (i)	0.0 (h)	0	15 AL	0.2 (c)	Internal corrosion of household plumbing, industrial manufacturer discharges

SECONDARY STANDARDS MONITORED AT THE SOURCE-FOR AESTHETIC PURPOSES

Sampled in 2020 - 2022 (b)	GROUNDWATER		SECONDARY MCL	MCLG or PHG	MAJOR SOURCES IN DRINKING WATER
	AVERAGE	RANGE			
Aggressiveness Index (corrosivity)	12.3	12.3	Non-corrosive	-	Natural/industrially-influenced balance of hydrogen/carbon/oxygen in water
Chloride (mg/l)	26.3	24.0 - 29.0	500	-	Runoff/leaching from natural deposits, seawater influence
Specific Conductance (uS/cm)	576.7	560 - 590	1,600	-	Substances that form ions when in water, seawater influence
Iron (ug/l)	70	ND - 210	300	-	Leaching from natural deposits; industrial wastes
Manganese (µg/l)	7.7	ND - 23	50	-	Leaching from natural deposits
Odor (Threshold Odor Number)	ND	ND	3	-	Naturally-occurring organic materials
Sulfate (mg/l)	81	77.0 - 84.0	500	-	Runoff/leaching from natural deposits, industrial wastes
Total Dissolved Solids (mg/l)	346.7	330 - 360	1,000	-	Runoff/leaching from natural deposits
Turbidity (NTU)	0.3	ND - 0.8	5	-	Soil runoff

SECONDARY STANDARDS MONITORED IN THE DISTRIBUTION SYSTEM-FOR AESTHETIC PURPOSES

GENERAL PHYSICAL CONSTITUENTS	DISTRIBUTION SYSTEM		SECONDARY MCL	MCLG or PHG	MAJOR SOURCES IN DRINKING WATER
	AVERAGE	RANGE			
Color (color units)	<3	<3	15	-	Naturally-occurring organic materials
Odor (threshold odor number)	1	1	3	-	Naturally-occurring organic materials
Turbidity (NTU)	0.3	0.1 - 1.0	5 Units	-	Soil runoff

ADDITIONAL CHEMICALS OF INTEREST			
Sampled in 2020-2022 (b)			
	GROUNDWATER		
	AVERAGE	RANGE	
Alkalinity (mg/l)	186.7	180 - 190	
Calcium (mg/l)	62.0	60.0 - 65.0	
Magnesium (mg/l)	13.3	13.0 - 14.0	
pH (standard unit)	7.8	7.7 - 7.8	
Potassium (mg/l)	3.4	3.2 - 3.6	
Sodium (mg/l) (MCL=None)	39.7	39 - 41	
Total Hardness (mg/l) (MCL=None)	210.0	200 - 220	

FOOTNOTES
(a) Over 50 regulated and unregulated volatile organic chemicals (VOCs) were analyzed. None were detected at or above the reporting limit in groundwater or surface water sources.
(b) Indicates dates sampled for groundwater sources only.
(c) California Public Health Goal (PHG). Other advisory levels listed in this column are federal Maximum Contaminant Level Goals (MCLGs).
(d) Combined Radium 226 + Radium 228 has a Maximum Contaminant Level (MCL) of 5 pCi/L.
(e) Running annual average used to calculate average, range, and MCL compliance.
(f) Maximum Residual Disinfectant Level (MRDL)
(g) Maximum Residual Disinfectant Level Goal (MRDLG)
(h) 90th percentile from the most recent sampling at selected customer taps.
(i) Lead Sampling in Schools: Recent events in the United States have shown that lead in drinking water remains an on-going public health concern, particularly for children. Lead rarely occurs naturally in California's drinking water sources, but may become present when water passes through older plumbing fixtures or solder containing lead that connects plumbing. In 2019, a total of 3 schools in the service area submitted request to be sampled for lead. Up to 3 to 4 samples were collected at each school and no results were detected at or above the action level of 15 parts per billion (ppb). No request for lead sampling was made in 2022.

ABBREVIATIONS		
AL = Regulatory Action Level	mg/l = milligrams per liter or (ppm) parts per million (equivalent to 1 drop in 42 gallons)	ND = constituent not detected at the testing limit
< = less than	NA = constituent not analyzed	ng/l = nanograms per liter or parts per trillion (equivalent to 1 drop in 42,000,000 gallons)
NTU = nephelometric turbidity units	pCi/l = picoCuries per liter (a measure of radioactivity)	µg/l = micrograms per liter or parts per billion (equivalent to 1 drop in 42,000 gallons)
SI = saturation index	uS/cm = microSiemens per centimeter	

DEFINITIONS
Maximum Contaminant Level (MCL): The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.
Maximum Contaminant Level Goal (MCLG): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the U.S. Environmental Protection Agency
Maximum Residual Disinfectant Level (MRDL): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.
Maximum Residual Disinfectant Level Goal (MRDLG): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants. MRDLGs are set by the U.S. Environmental Protection Agency.
Public Health Goal (PHG): The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.
Treatment Technique (TT): A required process intended to reduce the level of a contaminant in drinking water.
Regulatory Action Level (AL): The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.
Primary Drinking Water Standard (PDWS): MCLs, MRDLs and treatment techniques (TT) for contaminants that affect health, along with their monitoring and reporting requirements.
Secondary Drinking Water Standard (SDWS): MCLs and MRDLs for contaminants that affect the aesthetic qualities (taste, odor, or appearance) of drinking water. Contaminants with SDWSs do not affect the health at the MCL levels.

UNREGULATED CONTAMINANT MONITORING REGULATION (UCMR-4)


The Safe Drinking Water Act requires the Environmental Protection Agency (EPA) to identify unregulated contaminants for potential regulations. Every five years, EPA identifies a list of unregulated contaminants to be monitored for by the nation's water utilities over a three year period. This occurred in 2018-2020 with the fourth UCMR (UCMR-4). Walnut Park Mutual Water Company has monitored for a total of 30 chemical contaminants from its wells along with a corresponding sampling from the distribution system reflecting water from each well. Unregulated contaminant monitoring helps USEPA and the State Water Resources Control Board to determine where certain contaminants occur and whether the contaminants need to be regulated. Once EPA has obtained this occurrence data nationally, they are required to determine if there is a meaningful opportunity for increased health protection of drinking water by regulating these contaminants. The findings from this monitoring are reported in this year's Consumer Confidence Report.

FOURTH UNREGULATED CONTAMINANT MONITORING REGULATION (UCMR4)				
Monitored in 2019-2020				
CHEMICALS PARAMETERS	AVERAGE	RANGE	MINIMUM REPORTING LEVEL	USE OR ENVIRONMENTAL SOURCE
Manganese (ug/l)	3.6	3.0 - 4.1	0.4 ug/l	Naturally-occurring element; commercially available in combination with other elements and minerals; used in steel production, fertilizer, batteries and fireworks; drinking water and wastewater treatment chemical; essential nutrient other elements and minerals; used in steel production, fertilizer, batteries and fireworks; drinking water and wastewater treatment chemical; essential nutrient

LA COMPAÑÍA DE AGUA DE WALNUT PARK MUTUAL

INFORME DE CONFIANZA DE CONSUMIDOR 2022

Desde 1991, las agencias proveedoras de recursos hidráulicos de California han emitido información sobre el agua que se provee al consumidor. Este informe, preparado en mayo de 2023, es una instantánea de la calidad del agua del grifo que brindamos el año pasado. Incluimos detalles sobre el origen del agua que toma, cómo se analiza, que contiene, y cómo se compara con los límites estatales y federales. Nos esforzamos por mantenerle informado sobre la calidad de su agua, y proveerle un abastecimiento confiable y económico que cumpla con todos los requisitos.

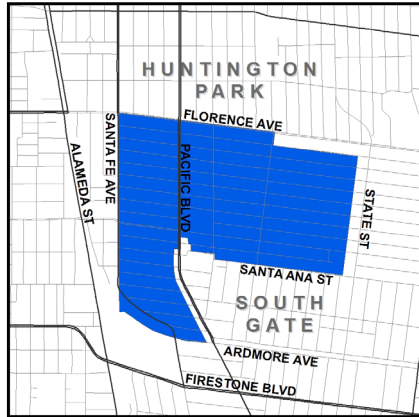

¿De Dónde Proviene el Agua que Tomo?

El agua del grifo proviene de la cuenca central. Estos pozos de agua subterránea profundos locales abastecen nuestra área de servicio que se muestra en el mapa adyacente.

La calidad de la agua subterránea entregada a su hogar se presenta en este informe.

¿Cómo Se Analiza Mi Agua Potable?

El agua que toma se analiza regularmente para asegurarnos de que no halla niveles altos de sustancias químicas, de radioactividad o de bacteria en el sistema de distribución y en las tomas de servicios. Estos análisis se llevan a cabo semanal, mensual, trimestral, y anualmente o con más frecuencia, dependiendo de la sustancia analizada. Bajo las leyes estatales y federales, se nos permite analizar algunas sustancias menos frecuentemente que los periodos anuales porque los resultados no cambian.

¿Cuales Son Los Estándares del Agua Potable?

La Agencia de Protección Ambiental Federal (USEPA) limita la cantidad de ciertas sustancias permitidas en el agua del grifo. En California, el Tablero de Control de Recursos de Echar agua Estatal (Bordo Estatal) regula la calidad de agua del grifo haciendo cumplir límites que son al menos tan rigurosos como el USEPA'S. Históricamente, los límites de California son más rigurosos que los Federales.

Hay dos tipos de límites conocidos como estándares. Los estándares primarios lo protegen de sustancias que potencialmente podrían afectar su salud. Las normas establecen los Niveles Contaminantes Máximos (MCL, en inglés) que se permite del contaminante primario o secundario en el agua de beber. Los abastecedores de agua deben asegurarse de que la calidad de esta cumpla con los Niveles Contaminantes Máximos (o MCLs, en inglés). No todas las sustancias tienen un Nivel Contaminante Máximo. El plomo y el cobre, por ejemplo, son regulados, por cierto nivel de acción. Si cualquier sustancia química sobrepasa el nivel de acción, se dará la

necesidad de un proceso de tratamiento para rebajar los niveles en el agua de beber. Los abastecedores de agua deben cumplir con los Niveles Contaminantes Máximos para asegurar la calidad del agua.

Las Metas para la Salud Pública (MSP [o PHGs, en inglés]) son establecidas por la agencia estatal de California-EPA. Las PHGs proveen más información con respecto a la calidad del agua, y son similares a los reglamentos federales nombrados Metas para Los Niveles de Contaminante Máximos (MNCM [o MCLGs, en inglés]). Las PHGs y MCLGs son metas a nivel recomendable. Las PHG y MCLG son ambas definidas como los niveles de contaminantes en el agua potable por debajo de los niveles donde no se esperan riesgos a la salud y no enforzables. Ambos niveles PHG y MCLG son concentraciones de una sustancia en las que no hay riesgos a la salud aún conocidos.

¿Cómo Interpreto Mi Informe de Calidad del Agua?

Aunque analizamos más de 100 sustancias, las normas nos requieren que reportemos solo aquellas que se encuentran en el agua. La primer columna en la tabla de la calidad de agua muestra la lista de las sustancias detectadas en el agua. La siguiente columna muestra la lista de la concentración promedio y el rango de concentraciones que se hallan encontrado en el agua que usted toma. En seguida están las listas de el MCL, el PHG y el MCLG, si estos son apropiados. La última columna describe las probables fuentes u origen de las sustancias detectadas en el agua potable.

Para revisar la calidad de su agua de beber, compare los valores por encima del promedio, mínimos y máximos y el Nivel Contaminante Máximo. Revise todos los químicos que se encuentran por encima del Nivel Contaminante Máximo. Si los químicos sobrepasan el Nivel Contaminante Máximo no significa que sea detrimental a la salud de inmediato. Más bien, se requiere que se realicen análisis más frecuentemente en el abastecimiento del agua por un corto período. Si los resultados muestran sobrepasar el MCL, el agua debe ser tratada para remover esa sustancia, o el abastecimiento de esta debe decomisionarse.

¿Por Qué Hay Tanta Publicidad Sobre La Calidad Del Agua Potable?

Las fuentes del agua potable (de ambas agua de la llave y agua embotellada) incluye ríos, lagos, arroyos, lagunas, embalses, manantiales, y pozos. Al pasar el agua por la superficie de los suelos o por la tierra, se disuelven minerales que ocurren al natural, y en algunas ocasiones, material radioactivo, al igual que pueden levantar sustancias generadas por la presencia de animales o por actividades humanas.

Entre los contaminantes que pueden existir en las fuentes de agua se incluyen:

- Contaminantes microbiales como los virus y la bacteria, los que pueden venir de las plantas de tratamiento de aguas negras, de los sistemas sépticos, de las operaciones de ganadería, y de la vida salvaje;

- Contaminantes inorgánicos, como las sales y los metales, los cuales pueden ocurrir naturalmente o como resultado del desagüe pluvial, industrial, o de alcantarillado, producción de gas natural y petróleo, minas y agricultura.
- Pesticidas y herbicidas, los cuales pueden venir de varias fuentes tales como la agricultura, del desagüe pluvial, y de usos residenciales;
- Contaminantes de otras sustancias químicas orgánicas, incluyendo químicos orgánicos volátiles y sintéticos que son productos de procesos industriales y de la producción de petróleo, y que pueden provenir de las estaciones de gasolina, desagües pluviales urbanos, y agricultura aplicación y de sistemas sépticos;
 - Contaminantes radioactivos, los cuales pueden ocurrir naturalmente o que pueden ser resultados de las actividades de la producción de gas natural y minería.

Para asegurarse que el agua potable sea saludable, el USEPA y el Tablero de Control de Recursos de Echar agua Estatal (Bordo Estatal) prescriben el reglamento o reglamentación que limita la cantidad de ciertos contaminantes en el echar agua proporcionado por sistemas de echar agua públicos. Las regulaciones de CDPH también establecen límites para contaminantes en el echar agua embotellado que debe proporcionar la misma protección para la salud pública.

Toda el agua potable, incluyendo el agua embotellada, puede contener cantidades pequeñas de ciertos contaminantes. La presencia de contaminantes no necesariamente indica que haya algún riesgo de salud. Para más información acerca de contaminantes y riesgos a la salud favor de llamar a la USEPA encargada de proteger el agua potable al teléfono (1-800-426-4791). Usted puede obtener más información sobre el agua potable al conectarse al Internet en los siguientes domicilios:

- <https://www.epa.gov/ground-water-and-drinking-water/safe-drinking-water-information>
(el sitio Web del USEPA)
- http://www.waterboards.ca.gov/drinking_water/certification/drinkingwater/NotificationLevels.shtml
(sitio Web de Bordo Estatal)

Si presente, los niveles elevados del plomo pueden causar el problema de salud serio, sobre todo para mujeres embarazadas y chiquitos. El plomo en el agua potable es principalmente de materiales y componentes asociados con líneas de servicios y a casa fontanería. Parque de Nuez la Compañía de Agua Mutua es responsable de proporcionar el agua potable de alta calidad, pero no puede controlar la variedad de materiales usados en la fontanería de componentes. Cuando su agua ha estado sentándose durante varias horas, usted puede minimizar el potencial para la exposición de plomo limpiando con agua su grifo durante 30 segundos a 2 minutos antes de usar el agua para beber o cocinarse. Si usted está preocupado por el plomo en su agua, usted puede desear hacer probar su agua. La información en el plomo en el agua potable, probando métodos, y pasos que usted puede tomar para minimizar la exposición está disponible de la Línea directa de Agua Potable Segura o en [http:// www.epa.gov/lead](http://www.epa.gov/lead).

¿Debería Tomar Otras Precauciones?

Algunas personas pueden ser más vulnerables a los contaminantes en el agua potable que el público en general. Las personas que tienen problemas inmunológicos, o sea esas personas que estén en tratamiento por medio de quimioterapia cancerosa; personas que tienen órganos transplantados, o personas con SIDA o desordenes inmunológicos, personas de edad avanzada, y los bebés que son particularmente susceptibles a ciertas infecciones. Estas personas deben de consultar a sus proveedores de salud médica. Las guías de la USEPA/Centros de Control de Enfermedades aconsejan cómo disminuir los riesgos para prevenir la infección de Cryptosporidium y otros contaminantes microbiales están disponibles por teléfono de la USEPA encargada de proteger el agua potable al teléfono (1-800-426-4791).

Valoración de su Abastecimiento de Agua

Walnut Park Mutual Water Company completó su evaluación de la fuente de agua en 2001. Los suministros de agua subterránea se consideran más vulnerables a las tuberías de productos químicos/petróleo, los tanques de almacenamiento sobre el suelo, el suministro de agua de pozo, los pozos de control/agujeros de prueba, las gasolineras de automóviles, los talleres de reparación de automóviles, los estacionamientos lotes/centros comerciales con más de 50 espacios, ferrocarriles, consultorios/clínicas médicas/dentales, apartamentos y condominios, y descarga permitida por NPDES/WDR. Se puede obtener una copia de la evaluación aprobada comunicándose con la oficina principal al (323) 585-7321 o enviando una solicitud por escrito a 2460 East Florence Avenue, Walnut Park, CA 90255.

¿Cómo Puedo Participar en las Decisiones Sobre Asuntos Acerca del Agua Que Me Puedan Afectar ?

Se invita al público a asistir a la reunión anual de accionistas ubicada en 2460 East Florence Avenue, Walnut Park, CA 90255, que se llevará a cabo el 19 de junio de 2023 a las 7:00 p. m. Las reuniones mensuales de la Junta se llevan a cabo cada tercer lunes a la 1:00 p. m.

¿Cómo Me Pongo En Contacto Con Mi Agencia del Agua Si Tengo Preguntas Sobre La Calidad Del Agua?

Si usted tiene preguntas sobre la calidad del agua potable, por favor llame a Michael Gomez al (323) 585-7321.

Algunas Puntas de Conservación de Agua Provechosas

Los · Fijan grifos agujereados en su casa – salvan hasta 20 galones cada día de cada agujero parado
 Los · Ahorran entre 15 y 50 galones cada vez por sólo lavando cargas máximas del lavado de ropa
 Los · Ajustan sus aspersores de modo que tierras de echar agua en su césped/jardín, no la acera/calzada – salven 500 galones por mes
 Los · Usan el pajote orgánico alrededor de plantas para reducir la evaporación – salvan cientos de galones un año
 Los · Apagan el echar agua cepillando sus dientes y salvan 25 galones por mes.
 Los - Visite <http://www.epa.gov/watersense> para obtener más información.

Visítenos en www.wpmwc.org